




INLET VIEW - SIZES 4 - 16

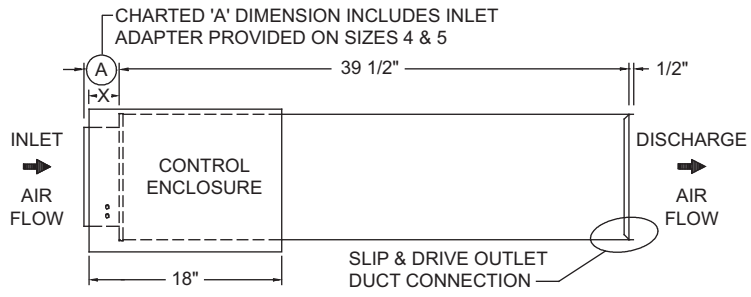

SIDE VIEW

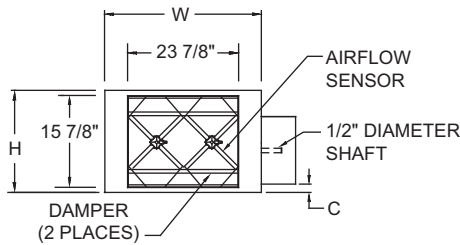

INLET VIEW - SIZE 22

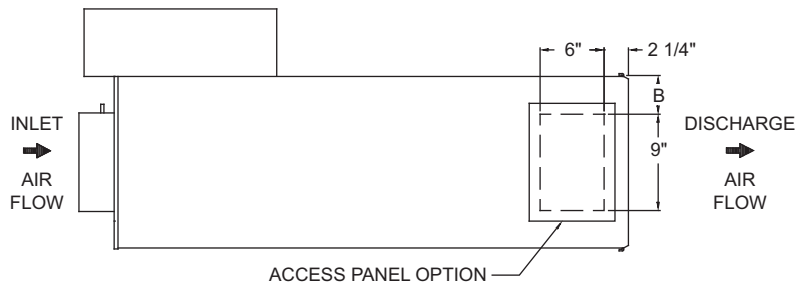

BOTTOM VIEW

NOTES:

1. Right-hand base unit with electric control enclosure shown. Left hand is available.
2. Unit hand determines the location of the control enclosure and damper shaft and is determined by looking into the unit inlet in the installed position.
3. Dimensions are given in inches.
4. Discharge side of box is fully open. Dimensions are in H x W, as listed.

35E UNIT SIZE	MAXIMUM CFM	W	H	A	B	C	D	X
04	230	12	8	5 ³ / ₈	1 ¹ / ₂	2 ¹ / ₈	3 ⁷ / ₈	7 ¹ / ₄
05	360	12	8	5 ³ / ₈	1 ¹ / ₂	2 ¹ / ₈	4 ⁷ / ₈	7 ¹ / ₄
06	515	12	8	3 ³ / ₈	1 ¹ / ₂	2 ¹ / ₈	5 ⁷ / ₈	7 ¹ / ₄
07	700	12	10	3 ³ / ₈	1 ¹ / ₂	1 ¹ / ₈	6 ⁷ / ₈	7 ¹ / ₄
08	920	12	10	3 ³ / ₈	1 ¹ / ₂	1 ¹ / ₈	7 ⁷ / ₈	7 ¹ / ₄
09	1160	14	12 ¹ / ₂	3 ³ / ₈	2 ¹ / ₂	-	8 ⁷ / ₈	5 ¹ / ₄
10	1430	14	12 ¹ / ₂	3 ³ / ₈	2 ¹ / ₂	-	9 ⁷ / ₈	5 ¹ / ₄
12	2060	16	15	3 ³ / ₈	3 ¹ / ₂	-	11 ⁷ / ₈	5 ¹ / ₄
14	2800	20	17 ¹ / ₂	3 ³ / ₈	5 ¹ / ₂	-	13 ⁷ / ₈	3 ¹ / ₄
16	3600	24	18	3 ³ / ₈	7 ¹ / ₂	-	15 ⁷ / ₈	3 ¹ / ₄
22	7000	38	18	4 ¹ / ₄	14 ¹ / ₂	1 ¹ / ₈	23 ⁷ / ₈ x 15 ⁷ / ₈	5 ¹ / ₄

PRODUCT INFORMATION IS SUBJECT TO CHANGE WITHOUT NOTICE.

04/01/2017

JOB NAME	JOB NUMBER	LOCATION		DRAWING NUMBER
BUYER	BUYER #	REVISION B	SHEET 1 OF 1	35E-202-2