
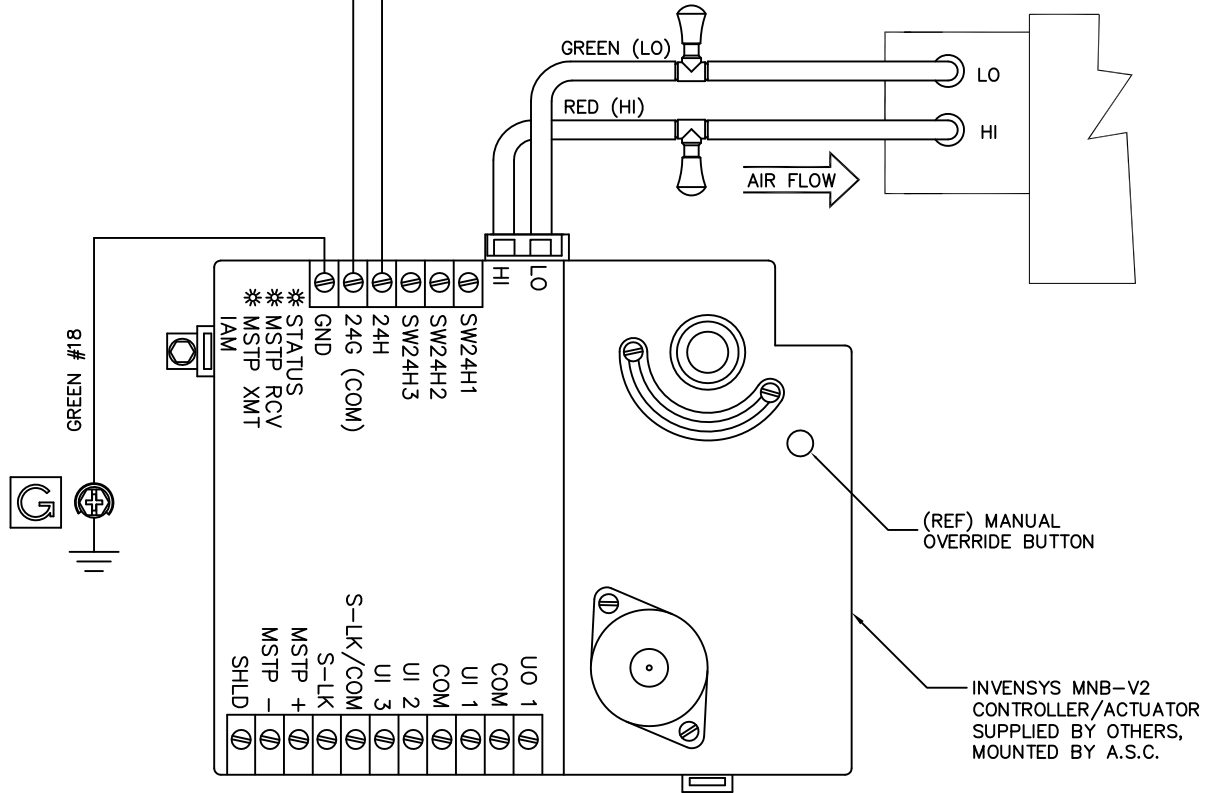
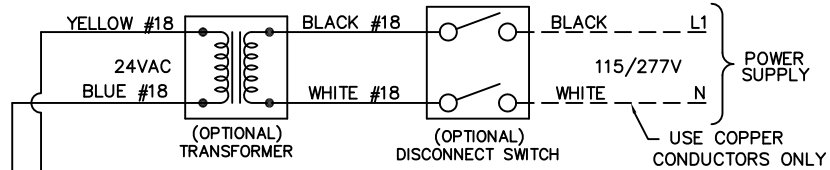


SINGLE DUCT TERMINAL UNIT WITH INVENSYS MNB-V2 CONTROLLER/ACTUATOR WITHOUT HEAT OR WITH HOT WATER HEAT.

CONTROL PACKAGE
IVDO

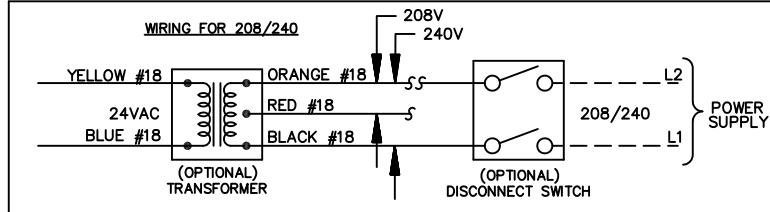


ACTUATOR NOTE:

VERIFY ACTUATOR BUSHING IS IN FULL CCW POSITION. ROTATE DAMPER CCW TO THE FULLY CLOSED POSITION. MOUNT ACTUATOR OVER DAMPER SHAFT AND SECURE TO SHAFT AND ENCLOSURE. ENGAGE CLUTCH AND ROTATE DAMPER CW TO THE FULLY OPEN POSITION.

FACTORY PIPING PROVIDED
 FACTORY WIRING PROVIDED
 WIRING BY OTHERS

THIS DOCUMENT AND ITS CONTENTS REMAIN THE EXCLUSIVE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT

A	K0001839	NSL	5/08	BSR	DRAWN BY	DATE
REV.	E. C. O. NUMBER	BY	DATE	APPVD	NSL	5/08
	351245IVDO				APPVD	DATE
	ASSEMBLY NUMBER		REPLACES OLD FORM/EFF. DATE		BSR	5/08



UNITED TECHNOLOGIES CARRIER

PO BOX 4808
SYRACUSE, NY 13221